


Verlauf Gesamtwasserhärte

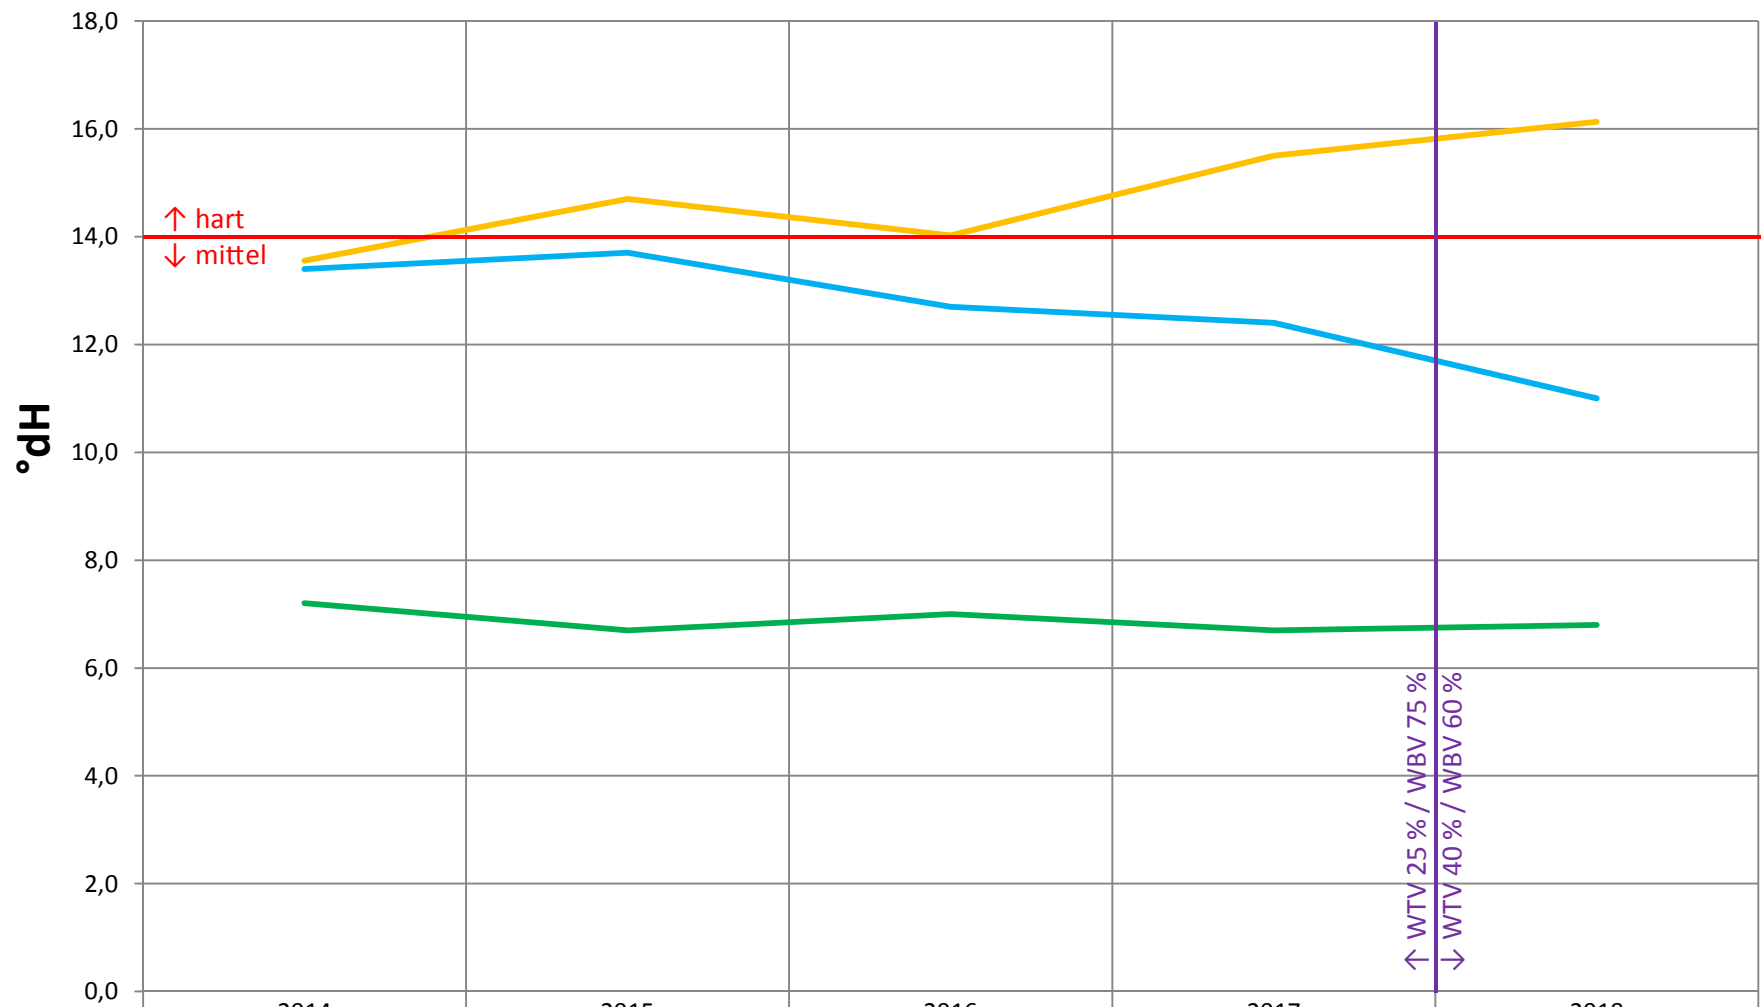

Wasserwerk BHM	13,40	13,70	12,70	12,40	11,00
WBV	13,55	14,70	14,02	15,50	16,13
WTV	7,20	6,70	7,00	6,70	6,80